

# T5 Tank Order - Submittal Sheet

Job Name \_\_\_\_\_

Contractor Signature \_\_\_\_\_

Orion Representative \_\_\_\_\_

Approval Date \_\_\_\_\_

Quantity of Tanks \_\_\_\_\_

Contractor's P.O. No. \_\_\_\_\_

**Note:** All quotes/pricing received from this submittal expire 30 days from day of quote.

Please e-mail your signed and completed submittal, tank quote and purchase order to [oriontanks@wattswater.com](mailto:oriontanks@wattswater.com).

## T5 Cylindrical Bolted Top Tank

### Specification

Orion T5 tank shall be cylindrical, seamless, stress and defect free, rotationally molded construction to uniform wall thickness from virgin PE resins conforming to ASTM D 1248, with **single FIP inlet with dip tube, outlet and vent as standard**. All penetrations shall be heat fused to tank wall. **Standard, non-load bearing, domed tank cover shall be bolted and gasketed to tank.**

### Tank Size

Selection	Capacity	Dimensions (in.)			Std.
Check One	USG Empty/Effective	Ht. (A)	Dia. (B)	Cover Dia.	In/Out/Vent Size (in.)
<input type="checkbox"/>	5/2	16	11	14	2/2/2
<input type="checkbox"/>	15/5	15.25	17.5	20.5	3/3/2
<input type="checkbox"/>	30/10	29.5	18	20.5	3/3/2
<input type="checkbox"/>	55/18	33	22	26	3/3/2
<input type="checkbox"/>	100/33	48	23.75	27.25	4/4/3
<input type="checkbox"/>	150/50	48.5	30	34.5	4/4/3
<input type="checkbox"/>	180/60	42.5	36.5	40	4/4/3
<input type="checkbox"/>	200/66	53.25	37.25	41.25	4/4/3
<input type="checkbox"/>	275/90	47	41.75	44.75	4/4/3
<input type="checkbox"/>	360/120	47.75	47.5	51.75	4/4/3
<input type="checkbox"/>	500/165	60	52	57	4/4/3
<input type="checkbox"/>	600/200	84	48	53	4/4/3
<input type="checkbox"/>	1200/400	84	69	74	4/4/3

### Connection, Cover, Support & Access Options

<input type="checkbox"/>	Optional No Hub Connections (FIP Std)	<input type="checkbox"/>	4" Cleanout Access
<input type="checkbox"/>	Optional Flanged Connections (FIP Std)	<input type="checkbox"/>	6" Cleanout Access
<input type="checkbox"/>	Tank Anchor Flange	<input type="checkbox"/>	12" Gamma Top Access
<input type="checkbox"/>	Reinforcing Anchor Flange	<input type="checkbox"/>	16" Gamma Top Access
<input type="checkbox"/>	Fiberglass Wrap*	<input type="checkbox"/>	20" x 3/4" Bolted Access
<input type="checkbox"/>	3/4" Plastic Cover	<input type="checkbox"/>	24" x 3/4" Bolted Access
<input type="checkbox"/>	1/4" Steel x 3/4" Plastic Cover (Not to be used in Conjunction w/Access Options)	<input type="checkbox"/>	High Level Alarm
<input type="checkbox"/>		<input type="checkbox"/>	DualStrn/Lvl/Leak Alarm

**⚠ CALIFORNIA PROP 65 WARNING:** This product can expose you to chemicals including benzene which is known to the State of California to cause cancer and birth defects or other reproductive harm. For more information go to [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov).

### NOTICE

The information contained herein is not intended to replace the full product installation and safety information available or the experience of a trained product installer. You are required to thoroughly read all installation instructions and product safety information before beginning the installation of this product.

Orion Fittings product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Orion Fittings Technical Service. Orion Fittings reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Orion Fittings products previously or subsequently sold.

USA: T: (800) 334-6259 • [OrionFittings.com](http://OrionFittings.com)

Canada: T: (888) 208-8927 • F: (888) 479-2887 • [OrionFittings.ca](http://OrionFittings.ca)

Latin America: T: (52) 55-4122-0138 • [OrionFittings.com](http://OrionFittings.com)

### Connection Locations/Sizes

(Choose One Location Only)



#### Standard Locations:

Inlet-at 9:00 and centered 4" down from the top of the tank rim  
Outlet-at 3:00 and centered 4" down from the top of the tank rim



Vent-at 6:00 & centered 3" down from top of tank rim

#### Custom Locations: C & D Dimensions Required

Indicate desired locations in the small circles of the top-view diagram below.




I-Inlet O-Outlet V-Vent

#### Custom Sizes:

Indicate 2", 3", 4", or 6" in corresponding connection-type box.

Inlet  Outlet  Vent

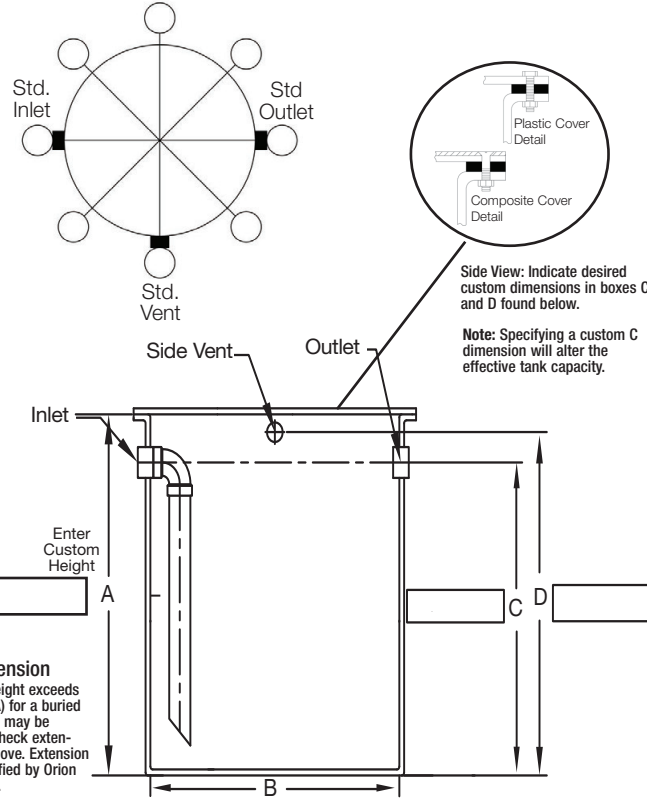

#### ☐ Tank Extension

If required tank height exceeds standard height (A) for a buried tank, an extension may be required. Please check extension option box above. Extension height will be verified by Orion Technical Support.

Note: Tanks are made to  $\pm 0.25$  in. tolerance.

Please verify all selections with your local Orion rep - tanks and accessory equipment are non-cancelable & non-returnable.

For technical advice contact: [oriontanks@wattswater.com](mailto:oriontanks@wattswater.com) (910) 865-7530



A WATTS Brand